


TO BE INSTALLED AND FURNISHED BY CUSTOMER

1. 5/8" X 8' galvanized or copper coated ground rod with U.L. approved clamp.
2. Customer to supply 200 AMP U.L. approved underground meter base.
3. Number 6 copper ground.
4. Install ground rod to the left or right of meterbase to allow for trencher boom.

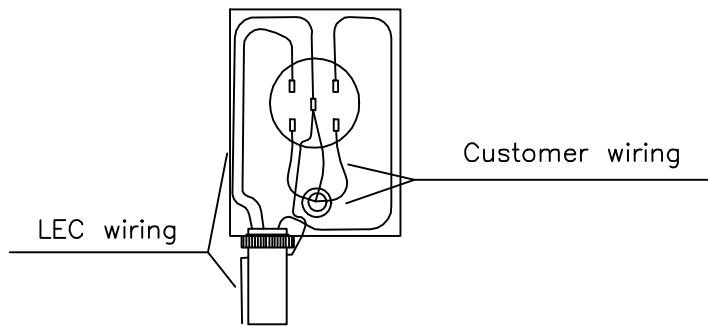

NOTES:

1. Meter location must be spotted by LEC personnel prior to installation.
2. Check local codes for all other applicable requirements.

